CITY OF BRYANT WATER AND WASTEWATER UTILITIES
MONTHLY LEAK ADJUSTMENT REPORT

SUMMARY
Date: June 2024

Total Number of Request for Adjustment		Total Number of Adjustments Approved	
Highest Bill Adjusted		Lowest Bill Adjusted	
Total Gallons Adjusted		Total Cost of Adjustments	

DETAILS

Customer Name	Rick Jamerson	Customer Address	2101 Whirlwind
Date Leak Detected by AMI		Date Customer Notified	
Date Leak Started		Date Leak Repaired	
Amount of Bill:	$985.90	Usage:	527
Average Bill:	$59.40	Three Month Average Usage:	22
Adjustment Approved:	Yes	No	Approved By:	
Amount of Adjustment to Sewer Bill:	$446.16	Adjusted Bill Amount:	$539.74
Customer Name	Rosetta Cleghorn	Customer Address	800 Prickett
Date Leak Detected by AMI		Date Customer Notified	
Date Leak Started		Date Leak Repaired	
Amount of Bill:	$666.69	Usage:	359
Average Bill:	$44.74	Three Month Average Usage:	< 20
Adjustment Approved:	Yes	No	Approved By:	
Amount of Adjustment to Sewer Bill:	$299.50	Adjusted Bill Amount:	$367.19
Customer Name		Customer Address	
Date Leak Detected by AMI		Date Customer Notified	
Date Leak Started		Date Leak Repaired	
Amount of Bill:		Usage:	
Average Bill:		Three Month Average Usage:	
Adjustment Approved:	Yes	No	Approved By:	
Amount of Adjustment to Sewer Bill:		Adjusted Bill Amount:	
Customer Name		Customer Address	
Date Leak Detected by AMI		Date Customer Notified	
Date Leak Started		Date Leak Repaired	
Amount of Bill:		Usage:	
Average Bill:		Three Month Average Usage:	
Adjustment Approved:	Yes	No	Approved By:	
Amount of Adjustment to Sewer Bill:		Adjusted Bill Amount:	
Customer Name		Customer Address	
Date Leak Detected by AMI		Date Customer Notified	
Date Leak Started		Date Leak Repaired	
Amount of Bill:		Usage:	
Average Bill:		Three Month Average Usage:	
Adjustment Approved:	Yes	No	Approved By:	
Amount of Adjustment to Sewer Bill:		Adjusted Bill Amount:	

CITY OF BRYANT WATER AND WASTEWATER UTILITIES
LEAK ADJUSTMENT REQUEST

Date of Request: 6/4/24
Customer Name: Rick Jamerson
Service Address: 2101 Whirlwind
City: Bryant
Date Leak Detected:

Service Account No.: 001-01449-06
Home Phone:
Work Phone:
State, Zip: AR 72022
Date Repaired:

Description of Cause of Leak (faucet, toilet, underground, etc.):

Toilet Leaking

Explanation of how leak was repaired: Attach plumbing invoice or receipts for repair parts

Sworn Statement:

I _____, swear or affirm that the above and foregoing representations are true and correct to the best of my information, knowledge, and belief.

_____
Signature

- You have the right to appeal the Customer Service Manager's decision to the Water and Sewer Advisory Committee (WSAC).
- If you are dissatisfied with the decision of the WSAC you have the right to appear before the Bryant City Council for a final decision.

FOR OFFICE USE ONLY

Amount of Bill:	$985.90	Usage:	527
Average Bill:	$59.40	Three Month Average Usage:	22
Adjustment Approved:	Yes ___ No ___	Approved By:	
Amount of Adjustment to Sewer Bill:	$446.16	Adjusted Bill Amount:	$539.74
Payment Plan: Yes ___ No ___	Payment Period: 3 Months ___ 6 Months ___	Payment Amt:	

_____
Customer Service Manager

Next Month

Greens at Hurricane Creek, a Limited Partnership
P O Box 13000
Fayetteville,AR 72703

Work Order No. 2583211
Date Call: 05/31/2024 11:08 PM

001-01449-06
479-755-7019

Status Work Completed

Date Completed: 06/01/2024 10:33 AM
Brief Desc: For some reason the toilet still ru

Job Site: 0114/2101
2101 Whirlwind Street
Bryant,AR 72022

Caller Name: Ricky jamerson

Caller Phone:
Occupant: Jamerson (t0258980)

Home (501) 304-3243x

Priority: 3-General
Ok to enter? NO
Category: Plumbing
Animal in Apt? No

SubCategory: Other

6/4/24

Problem Description: For some reason the toilet still running it will shut off and come back on

Parts & Labor

Quantity/ Hours	Item Type/ Employee Name	Description	Unit Price	Total
.00	Williams	Williams	.00	.00
			Total	.00

Authorized by: _____
Signed by _____
Dated _____
Invoice No. _____

Full Description For some reason the toilet still running it will shut off and come back on

Technician Notes: replaced red seal

CITY OF BRYANT WATER AND WASTEWATER UTILITIES
LEAK ADJUSTMENT REQUEST

Date of Request: 6/24
Customer Name: Rosetta Cleghorn
Service Address: 800 Prickett
City: Bryant
Date Leak Detected:

Service Account No.: 102-00643-00
Home Phone:
Work Phone:
State, Zip: AR 72022
Date Repaired:

Description of Cause of Leak *(faucet, toilet, underground, etc.)*:

Service Line Leaking

Explanation of how leak was repaired: *Attach plumbing invoice or receipts for repair parts*

Sworn Statement:

I _____, swear or affirm that the above and foregoing representations are true and correct to the best of my information, knowledge, and belief.


_____
Signature

- You have the right to appeal the Customer Service Manager's decision to the Water and Sewer Advisory Committee (WSAC).
- If you are dissatisfied with the decision of the WSAC you have the right to appear before the Bryant City Council for a final decision.

Calculation of Refund

Amount of Bill:	$666.69	Usage:	359
Average Bill:	$44.74	Three Month Average Usage:	220
Adjustment Approved:	Yes ____ No ____	Approved By:	
Amount of Adjustment to Sewer Bill:	$299.50	Adjusted Bill Amount:	$367.19
Payment Plan: Yes ____ No ____		Payment Period: 3 Months ____ 6 Months ____	Payment Amt:

Customer Service Manager

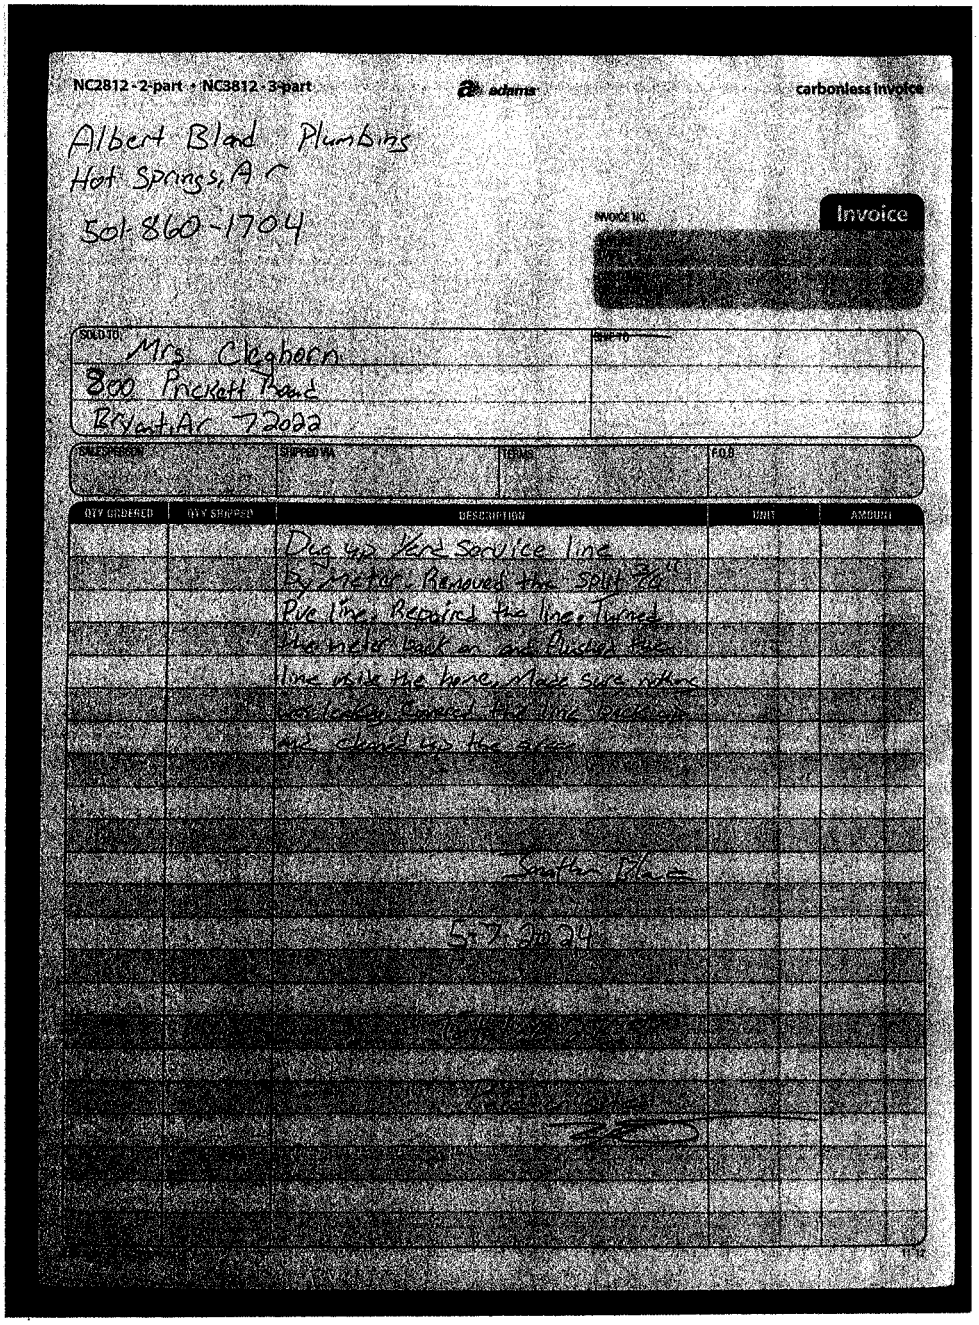

NC2812 - 2-part • NC3812 - 3-part adams carbonless invoice

Albert Bland Plumbing
Hot Springs, AR
501-860-1704

Invoice

INVOICE NO.

SOLD TO: Mrs. Cleghorn
800 Prickett Lane
Bryant, AR 72022

SHIP TO

SALESPERSON	SHIPPED VIA	TERMS	F.O.B.

QTY ORDERED	QTY SHIPPED	DESCRIPTION	UNIT	AMOUNT
		Dug up Yard Service line 3' by 2' deep. Removed the split 3/4" Pvc line. Repaired the line. Turned the meter back on and flushed the line inside the home, made sure water was leaking. Covered the line backup and cleaned up the area.		
		Total $ [redacted]		
		5-7-2024		

102.00643-00
501-584-8990